



## **RT520 THERMOSTAT - FULL USER MANUAL**



### TABLE OF CONTENTS

1. Introduction	4
1.1 Product Compliance	
1.2 Safety Informations	
2. Product Overview	
2.1 Example of boilers compatible with the OpenTherm OT+ 4.0 protocol	
2.2 Montage	
2.3 Package content	
2.4 Proper thermostat location	
2.5 Connection description	
I A - Boiler connection	
<b>I B -</b> Pump / Valve connection	
I C - KL08NSB underfloor heating wiring center connection	8
3. Before you start (first power up)	
3.1 LCD icon description	
3.2 Button description	
3.3 First power up sequence and configuration	
3.4 OpenTherm - Hot Water configuration	14
4. User settings	11
4. User settings	L I
4.2 Schedule mode - programming schedule	
4.3 Switching between manual and schedule mode	
4.4 BOOST mode - hourly temperature override (+Hr)	
4.5 Control and Heat/Cool settings	
4.6 Landlord settings	
4.7 Time/Date	
4.8 Holiday mode	
4.9 Language	
5. Factory Reset	
6. Error codes	
7. Battery change	2
8. Cleaning and Maintenance	20
	-
9. Technical Informations	
10. Warranty	



#### 1.1 Product Compliance

This product complies with the essential requirements and other relevant provisions of Directives 2014/53/EU and 2011/65/EU. The full text of the EU Declaration of Conformity is available at the following internet address: www.saluslegal.com.

#### 1.2 Safety Informations

Before starting installation work and before using the product, read the entire manual.

• The information contained in the instructions is essential for proper functioning.

To avoid accidents resulting in personal injury and material damage, please follow all safety precautions, specified in this manual.

• The device should not be used by people with limited mental, sensory or mental abilities, without experience, of insufficient knowledge as well as children.

• Do not use an unassembled device (eg without a cover).

The device may only be opened by a qualified person.

 Keep electrical devices out of the reach of children and ensure that they do not play with it. Children should not be left unattended. If necessary, disconnect the control system for the entire room.

• Do not leave the packaging, cabinet, or any loose parts of the device unattended, as they pose a risk to children.

#### WARNING!

 Installation must be carried out by a qualified person with appropriate electrical qualifications in accordance with standards and regulations in force in the given country and in the EU.

Never try to connect the device other than as described in the manual.

 Before assembly, repair or maintenance as well as during any connection works it is absolutely necessary disconnect the mains supply and make sure that the terminals and electric wires are not live.

The device may not be exposed to extreme temperatures, strong vibrations or subjected to mechanical shock.

• The device should not be used in unfavorable environmental conditions or in rooms where there is a concentration of flammable gases, fumes or dust.

#### WARNING!

• There may be additional protection requirements for the entire installation that the installer is responsible for maintaining.

#### 2. Product Overview

The RT520 room thermostat simply switches the heating system on and off as necessary. It works by sensing the air temperature, switching on the heating when the air temperature falls below the thermostat setting, and switching it off once this set temperature has been reached.

Turning a room thermostat to a higher setting will not make the room heat up any faster. How guickly the room heats up depends on the design of the heating system, for example, the size of boiler and radiators. Neither does the setting affect how guickly the room cools down. Turning a room thermostat to a lower setting will result in the room being controlled at a lower temperature, and saves energy.

The heating system will not work if a time switch or programmer has switched it off.

The way to set and use your room thermostat is to find the lowest temperature setting that you are comfortable with, and then leave it alone to do its job. The best way to do this is to set the room thermostat to a low temperature - say  $18^{\circ}$ C - and then turn it up by one degree each day until you are comfortable with the temperature.

You won't have to adjust the thermostat further. Any adjustment above this setting will waste energy and cost you more money.

If your heating system is a boiler with radiators, there will usually be only one room thermostat to control the whole house. But you can have different temperatures in individual rooms by installing thermostatic radiator valves (TRVs) on individual radiators. If you don't have TRVs, you should choose a temperature that is reasonable for the whole house. If you do have TRVs, you can choose a slightly higher setting to make sure that even the coldest room is comfortable, then prevent any overheating in other rooms by adjusting the TRVs.

Room thermostats need a free flow of air to sense the temperature, so they must not be covered by curtains or blocked by furniture. Nearby electric fires, televisions, wall or table lamps may prevent the thermostat from working properly.

Thermostat is compatibile with OpenTherm OT+ 4.0 version.

The OpenTherm protocol is an open standard communication protocol used in central heating systems for two-way communication between a central heating boiler and a room thermostat. Thanks to the communication protocol, the boiler power is modulated, which can significantly increase the energy efficiency of the heating system while maintaining the set temperature in the room. OpenTherm modulation, compared to standard communication (ON / OFF), occurs by setting the desired temperature of water from the boiler (boiler power), and not by its cyclical switching on and off.



Make sure your gas combi boiler is compatible with OT + 4.0 communication protocol. The list of compatible boilers is on the next page.

#### Product advantages:

- automatically detects OT + 4.0 protocol and regulates hot water temperature
- possibility to choose Hysteresis or built-in TPI algorithm for all types of heating
- works with time schedules
- service mode protected by a PIN code
- maximum / minimum temperature limitation
- can temporarily change the temperature (overwriting until the next program change)

1	1			/
		1	-1	2
		V	$\triangleleft$	
	1	1	-0	1
1	/		•	1

Care for the natural environment is of paramount importance to us. The awareness that we manufacture electronic devices obliges us to dispose of used electronic components and devices safely. Therefore the company has received a registration number issued by the Chief Inspector for Environmental Protection. The crossed out symbol the trash can on the product means that the product must not be disposed of with ordinary waste containers. Sorting waste for recycling helps to protect the environment. It is the user's responsibility to surrender used equipment to a designated collection point for recycling waste from electrical and electronic equipment.

COMPANY	MODEL	COMPANY	MODEL	
Alpha Heating	E-Tec S E-tec Plus E-tec Evoke	Vokera	Linea HE Mynute A Mynute HE Unica HE	
Atag	Intec GS iC iC Economiser iS		Vitodens 100W Typ WB1A (Connection: X3.3 and X3.4) Vitodens 100W Typ WB1B (Connection: X21.1 and X21.2) Vitodens 100W Typ WB1C (Connection: X21.1 and X21.2)	
Baxi	100 Combi 200 Combi 400 Combi 600 Combi	Viessmann	Vitodens 200-W WB2B 26+ 35 kW (via Expansion Mo- dule OT and OT-A8 + _Terminal -10 and +10 are on the extension of the A8 boiler) Vitodens 200-W WB2C, B2HA,B2JA, B2LA (via icm	
Daikin	D2CND 24Kw D2CND 28kw D2CND 35kw i25 Condensing Combination Boiler	Vaillant (via Vaillant VR33 module)	Expander OpenTherm) Ecotec Pro Ecotec Plus Ecotec Exclusive	
Ferroli	i29 Condensing Combination Boiler	VK33 module)	Ecofit Pure	
ldeal	Independent + Combi Independent Combi Independent System Logic Combi + Combi C Logic Combi C24, C30, C35 (via a separate bundle set) Logic Code Combi (via a separate bundle set) I-mini C24, c30 (via a separate bundle set) Vogue Combi C26,C32, C40 Logic + System Logic + Heat	Worcester Bosch (via Nefit EMS-OT OpenTherm	EMS capable boilers Greenstar i Greenstar i Junior (Made in July 2013) Greenstar Si Compact Greenstar CDi Compact Greenstar CDi Classic (Made after 16.01.2007 with CF12.10 software version and newer) Greenstar Highflow CDi Greenstar 12i System – 24i System (On condition that an optional integrated diverter valve manufactured after February 2011 is installed) Greenstar 27i System – 30i System (Provided the optio- nal Integrated Changeover Valve is installed Greenstar CDi Classic System (provided the optional Integrated Changeover Valve manufactured after 02/16/2007 with software version CF12.10 and above is installed))	
Intergas	Intergas Rapid Intergas Rapid Plus Combi Compact, Compact Range ECO RF Xtreme Xclusive	converter)		
Main	Eco Compact Combi 25-30			
Navien	Navien NCB			
Ravenheat	Avanta, Quinta Ace Quinta Pro Gas 110 Eco			
Vokera	Evolve C Evolve S Linea One (przez OpenTherm Kit Part_1221179) Vision Combi (requires a control interface 294501430 Compact A (requires a control interface 29450143) Verve (only heating mode) Mynute I (only heating mode) Vision System (only heating mode) Unica I Vibe Vision C			


#### 2.2 Montage

#### 2.3 Package content

1) RT520 thermostat
2) Back housing
3) 2x AA batteries
4) Short instruction
5) Mounting screws



#### 2.4 Proper thermostat location

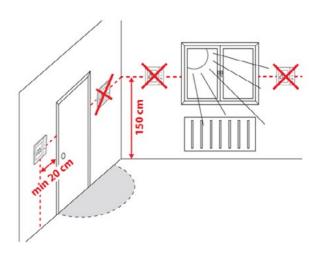




# The ideal position to thermostat mounting is about 1,5m under floor level far from heating or cooling sources. Thermostat can't be exposed to sunlight or any extreme conditions like for example draft.

Because of fire and explosion risk there is not allowed to use thermostat in atmosphere of explosive gases and flammable liquids (eg coal dust). In case if any of listed dangers occur you have to use additional protection measures – anti-dust and explosive gases (tight cover) or prevent their formation. Furthermore, thermostat can't be used in condensation of water vapor conditions and be exposed to water action.




#### 2.5 Connection description


#### I A - Boiler connection

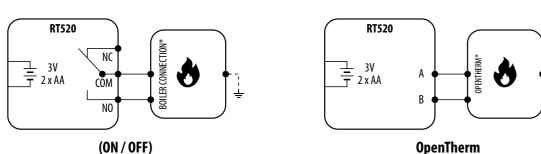


#### IB - Pump / Valve connection



#### IC - KL08NSB underfloor heating wiring center connection

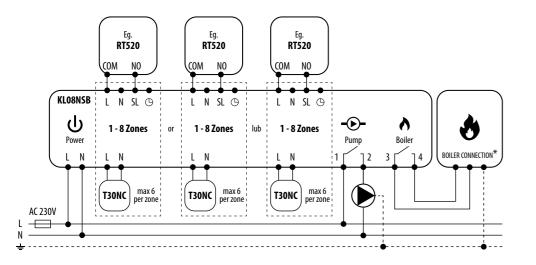

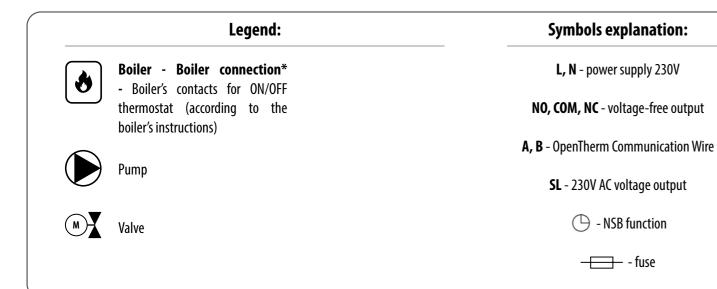

#### 3. Before you start (first power up)

#### 3.1 LCD icon description

### 1 MON 2 TUE 3 WED 4 THU 5 FRI 6 SAT 7 SUN 4 SET 5 PROGI6

Text Bar
Temperature Unit
Day of the week (numeric)
Day of the week (alphabetic)
Clock
AM / PM
Cooling Mode On
Holiday Mode On
Manual Mode On

#### 3.2 Button description



 MENU / RETURN - enter the menu options, press and hold for 3 sec to return to main screen or to deactivate Boost or Manual modes.
SELECT - confirm changes and enter menus.
DOWN - decrease the temperature and move through the menus.







- 9. Heating Mode On
- 10. Low battery status
- **11.** Wireless connection with the receiver
- 12. Service Mode On
- **13.** Temperature measured / set
- 14. Program number
- 15. Settings
- 16. Program indicator
- 17. Boost function


- **4.** UP increase the temperature and move through menus.
- 5. BOOST activate Boost Mode.
- 6. MANUAL press once to activate / press and
- hold for 3 sec to deactivate Manual Mode.

#### 3.3 First power up sequence and configuration

 $(\mathbf{i})$ Please make the receiver connections and power the receiver before inserting the batteries into the thermostat.

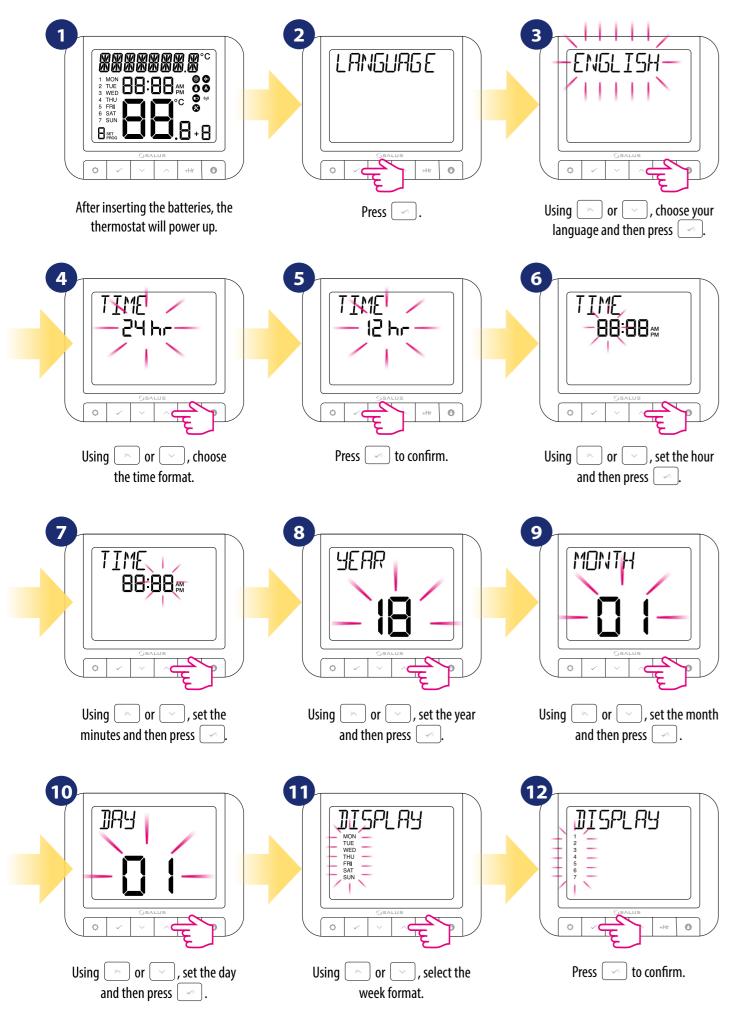


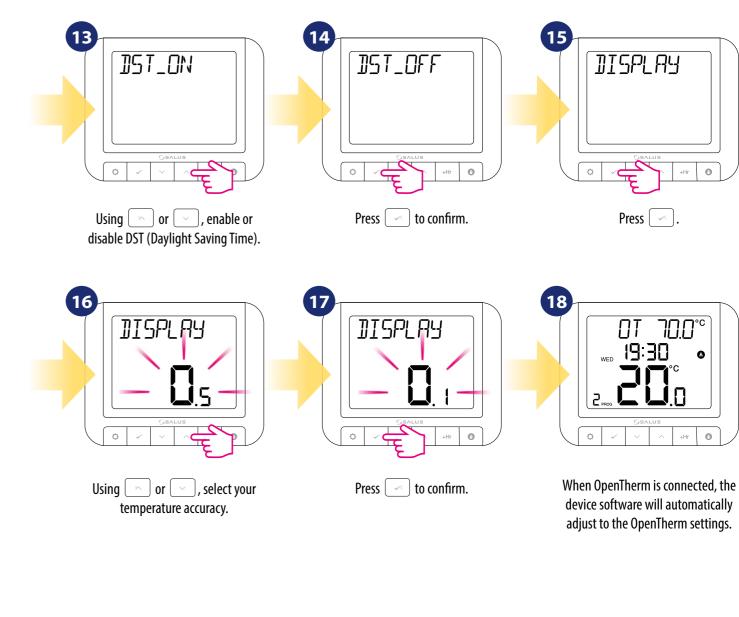



Press [

TPI (Time Proportional & Integral) is a self-learning, time-proportional algorithm. TPI type of regulation ensures economical system operation through more accurate temperature maintenance during controlling process and limits overload conditions. In addition to the exact and stable room temperature, the advantage of this system is the minimization of energy consumption and significant savings. RT520 offers 3 types of TPI control: 1. for radiator (6CPH); 2. for underfloor heating (3CPH); 3. for electric heating (9CPH).



specified in the schedule.






 $\frown$  or  $\bigcirc$  , select the TPI type you want to use. Using



Press 🔄 to confirm.



28

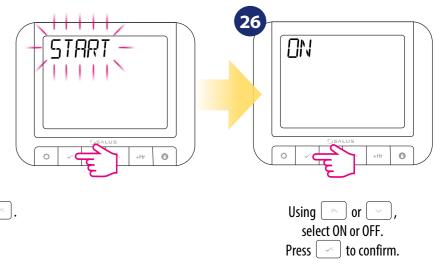







Span is the difference between the measured temperature and the set temperature.

27 OPTIMUM STOP -1111 <u>لے</u> 0

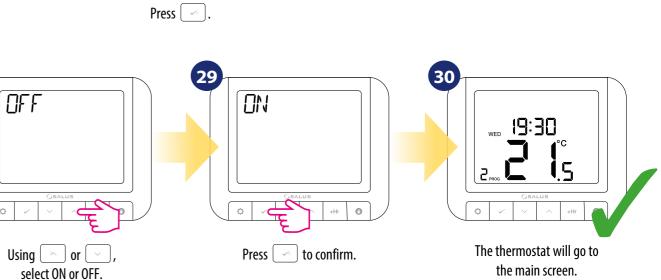





The optimization function is an energy-saving algorithm used for efficient control of the heating device, ensuring better thermal comfort at certain times of the day. When the OPTIMUM START function is active, the thermostat sends a heating signal to the heat source beforehand so that the preset temperature in the room is reached at the time




When the OPTIMUM STOP function is active, the thermostat, taking into account the inertia of the system, switches off the heat source earlier, keeping the temperature set in the schedule.

#### 3.4 OpenTherm - Hot Water configuration

main screen. Press any button.

RT520 can be configured in Hot Water OPENTHERM system. To configure it follow steps below:

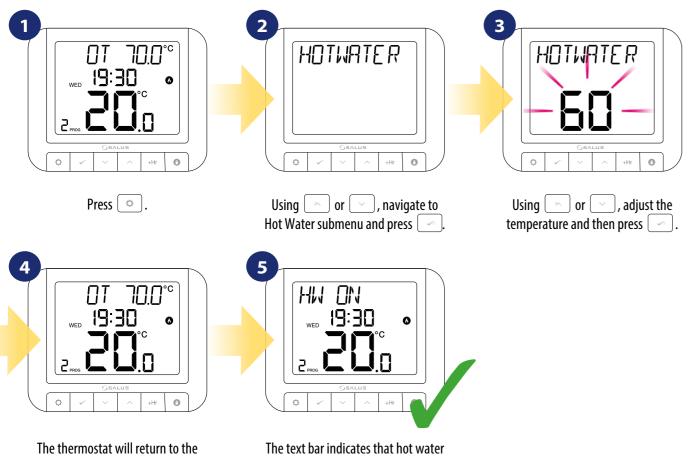

is in operation.

#### 4. User settings


#### 4.1 Manual mode

In manual mode, the thermostat maintains a constant temperature set by the user. To exit mode, press and hold 💿 button for 3 seconds. A hand icon is displayed when manual mode is active.



Press 💿 button.









Confirm your choice using 🧭 ] button.

temperature until manual change or manual mode exit (press and hold button for 3 seconds).






or 🖂 button.

Thermostat will maintain the

#### 4.2 Schedule mode - programming schedule


In this mode, user can set the schedules for thermostat (temperature setpoints for specific periods of time). Programmed schedules should use all time periods.

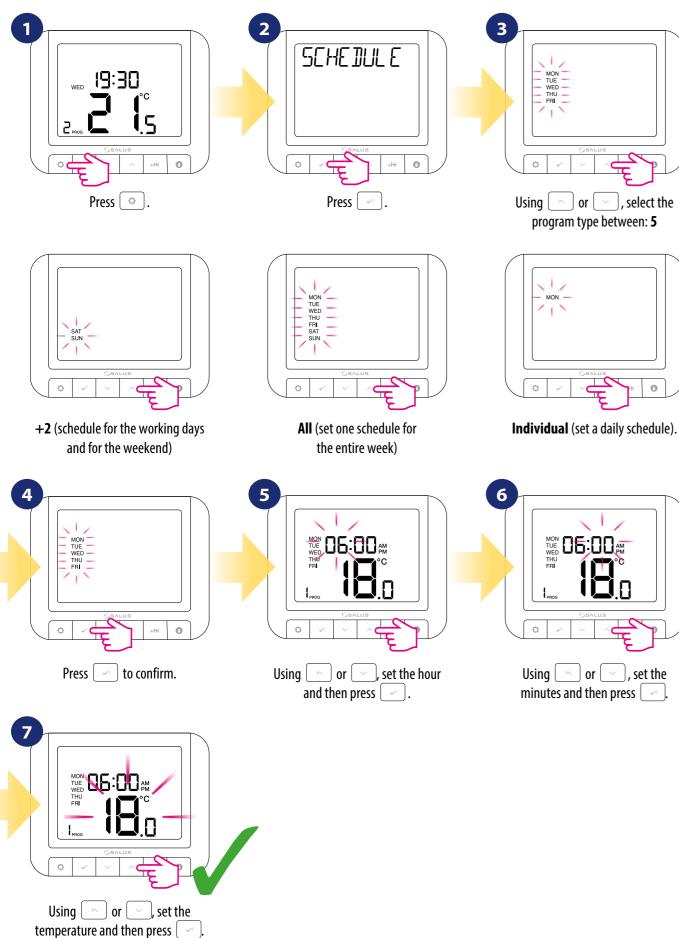

#### 4.3 Switching between manual and schedule mode

In this option, user can switch between manual and schedule mode by using 💿 button. To do that please follow steps below:



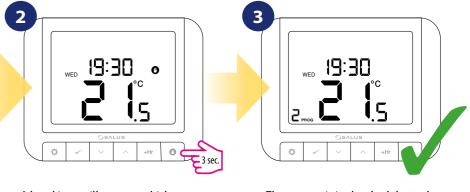

Press 💿 button.

Now press and hold 💿 button.

i

A hand icon will appear, which means that thermostat is in manual mode.


Thermostat is in the shedule mode again.

#### 4.4 BOOST mode - hourly temperature override (+Hr)

The function is available in automatic and manual mode. Used to change the temperature to the desired value for a specified number of hours (up to 9 hours). After the elapsed time, the thermostat returns to the previous operating mode.

#### 2 3 1 1200/0 MON 12:00 15:00 O **— — — — —** Ę \***\_\_**\_ Ô

Press +Hr button to set hour for temporary override (eg. 4 hours = 4 times button pressing). Confirm by 🧹 🖉 button.








Thermostat is working in BOOST mode for 4 hours and it will maintain temperature setpoint for 4 hours.

#### 4.5 Control and Heat/Cool settings


In this option user can set control algorithm (TPI, SPAN or Optimize) and set Heat / Cool mode. Please follow the steps below:

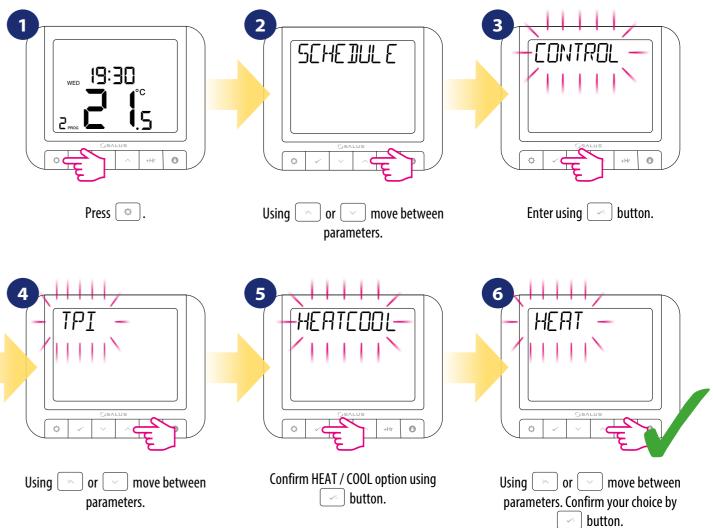



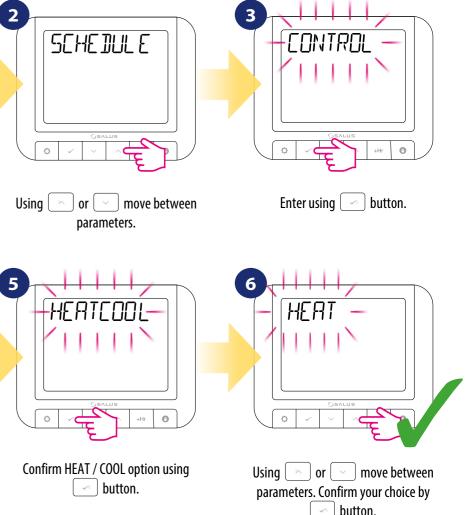

How to stop BOOST mode:



Hold • button for 3 seconds or press +Hr button several times until "+0" will appear and confirm by button.




Thermostat will go back to main screen and previous work mode.



#### 4.6 Landlord settings

Landlord settings is a pin code protected feature that allows the landlord to set a service reminder on the thermostat that will warn the tenant when the boiler is due its annual service.

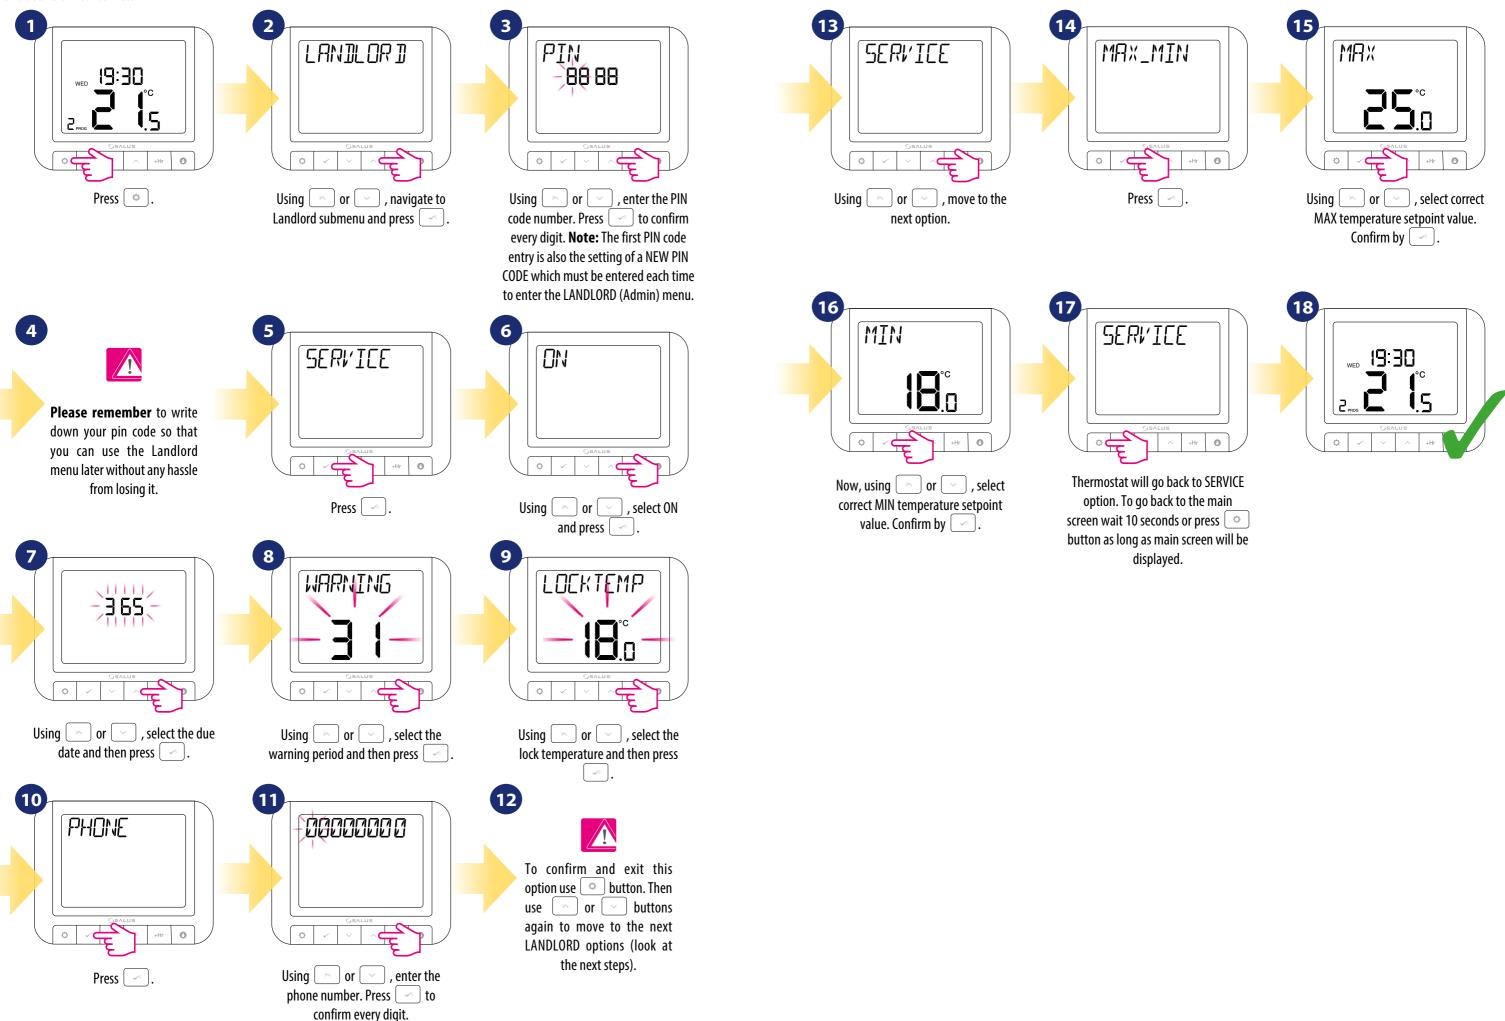



#### 4.7 Time/Date

To set time/date follow steps below:

# 4.8 Holiday mode


Holiday mode is a special program temperature setpoint which thermostat will maintain for specified days. How to set **HOLIDAY MODE:** 

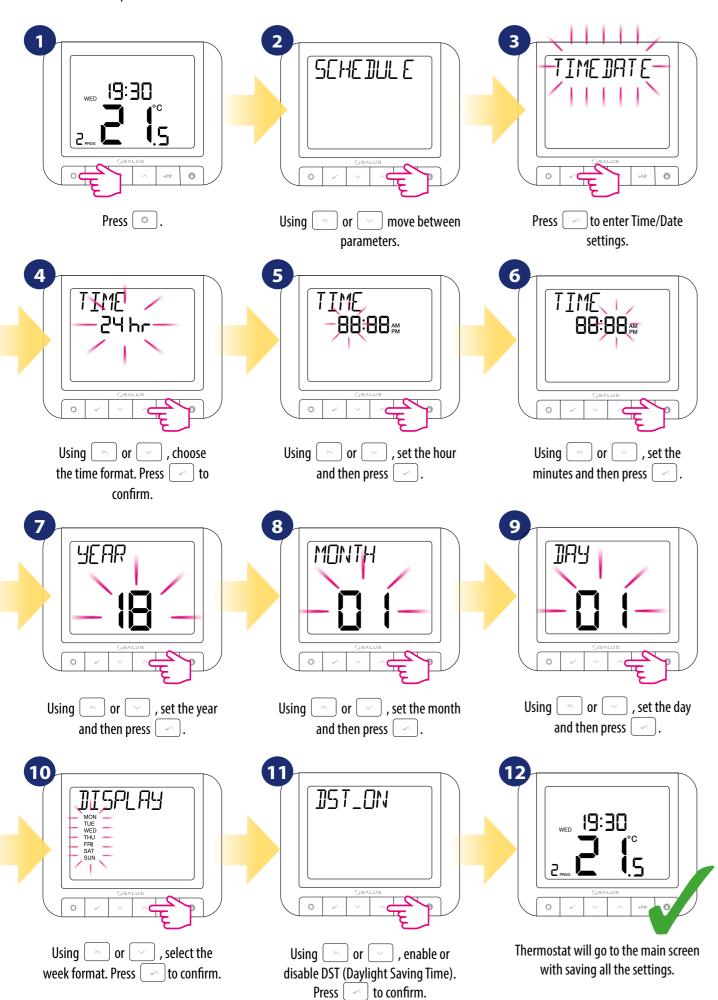

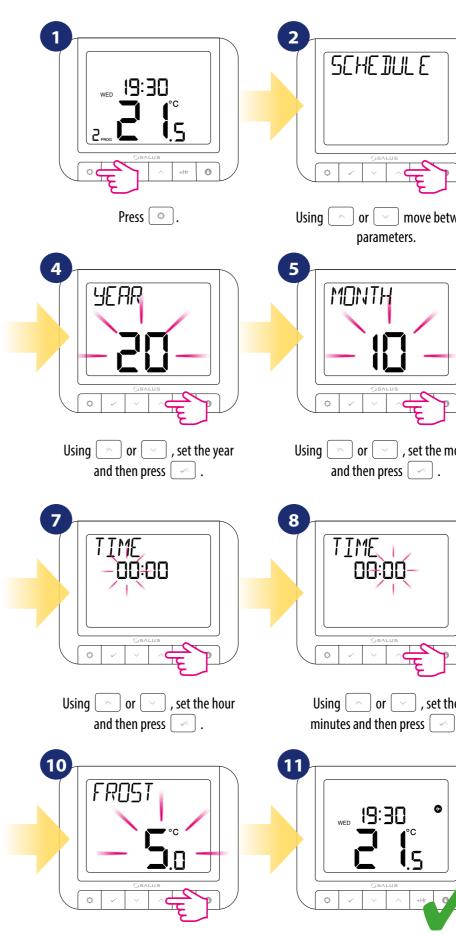


Using [ > ] or [ > ] , set the temperature which should be maintaned during holiday mode and then press [

holiday mode.

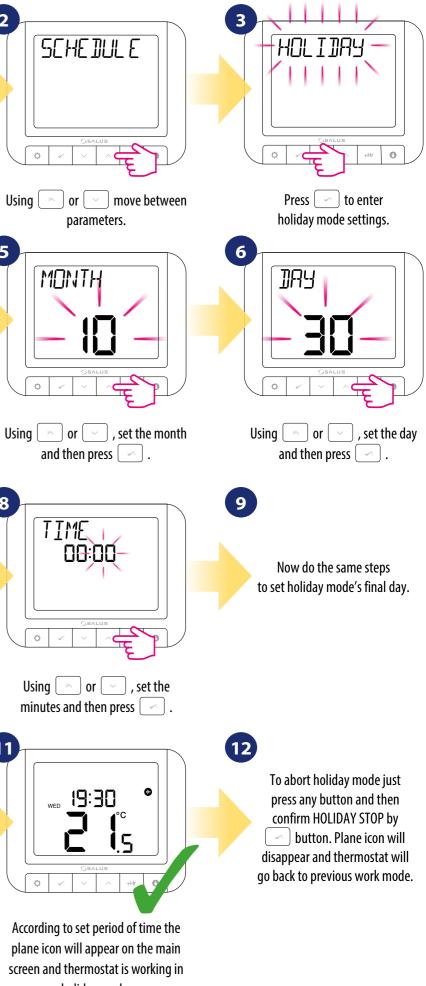

#### 4.9 Language

To choose language follow steps below:

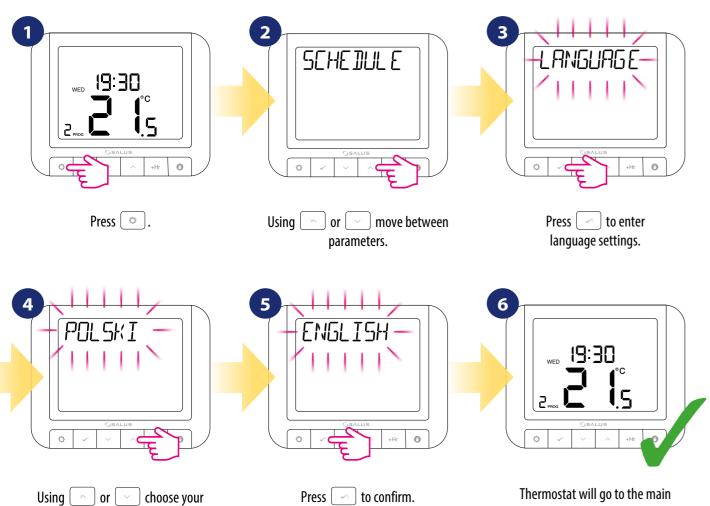

choose your language.

Press v to confirm.



Thermostat will go to the main screen with saving the changes.

#### 5. Factory Reset

To RESET RT520 thermostat to it's factory default settings please follow steps below:



2 

To reset the thermostat press and hold together  $\bigcirc$  +  $\bigcirc$  + +++buttons for 5 seconds.

Thermostat has been reseted. PLEASE NOTE: User settings will not be deleted.


#### 6. Error codes



Thermostat will display errors only when it's connected to the boiler by OPENTHERM terminals (A / B). Please refer then to boiler manual. Each boiler can have different error codes.

#### 7. Battery change

Turn the thermostat over so that the back is in front of you. Now look at the picture below:

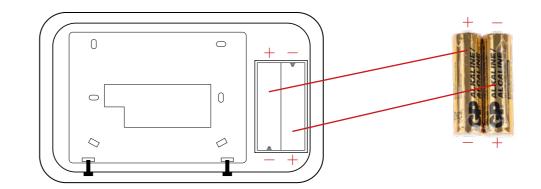

INSERT THE BATTERIES, PAYING ATTENTION TO THEIR POLARITY!



#### 8. Cleaning and Maintenance

The **RT520 thermostat** requires no special maintenance. Periodically, the outer casing can be wiped clean using a dry cloth (please D0 NOT use solvents, polishes, detergents or abrasive cleaners, as these can damage the thermostat). There are no user serviceable parts within the unit; any servicing or repairs could only be carried out by **Salus Controls** or their appointed agents.


#### 9. Technical Informations

Power supply	2 x AA batteries
Rating max	3 (1) A
Output signal	OpenTherm (A / B) or voltage free relay (NC / COM / NO)
Temperature range	5 - 33.5°C
Display temperature accuracy	0.1°C or 0.5°C
Control algorithm	TPI or Hysteresis: $\pm 0.25^{\circ}$ C or $\pm 0.5^{\circ}$ C
Communication	Wired
Dimension [mm]	95 x 118 x 26

#### 10. Warranty

SALUS CONTROLS warrants this product to be free from any defects in material or workmanship and to perform as specified for a period of five years from the date of installation. SALUS CONTROLS reserves the sole responsibility for breach of this warranty by repairing or replacing the defective product. This product includes software that matches the distributor's identification at the time of sale. The manufacturer / distributor provides a guarantee covering all functions and specifics of the product in accordance with this marking. The distributor's warranty does not cover the correct operation of the functions and features available as a result of a product software update. The full warranty conditions are available at www.salus-controls.eu

Customer	Name:
Customer	Address:
Tel No:	Email:
Company	Name:
	Name: Email
Tel No:	
Tel No: Installatio	Email

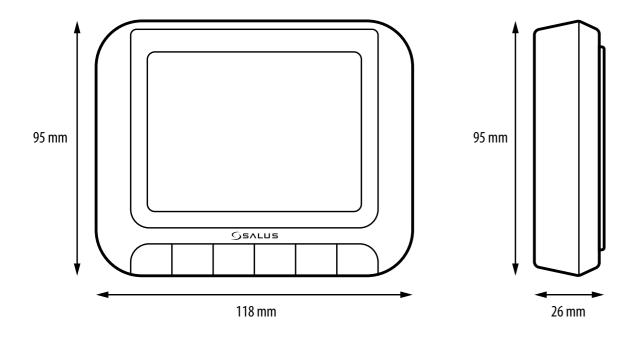

t Code:

IMPORTER: QL CONTROLS Sp. z o.o. Sp. k. ul. Rolna 4, 43-262 Kobielice

PRODUCER: Salus Limited 6/F, Building 20E, Phase 3, Hong Kong Science Park, 20 Science Park East Avenue, Shatin, New Territories, Hong Kong





## www.salus-controls.eu

### SALUS Controls is a member of the Computime Group.

Maintaining a policy of continuous product development SALUS Controls plc reserve the right to change specification, design and materials of products listed in this brochure without prior notice.

Ver. 3 Issued: 19 III 2021 Soft version: 2.2

